

# കോഴിക്കോട് മുനിസിപ്പൽ കോർപ്പറേഷൻ



Email : [secretarykkd@gmail.com](mailto:secretarykkd@gmail.com) Website : [www.kozhikodecorporation.lsgkerala.gov.in](http://www.kozhikodecorporation.lsgkerala.gov.in)  
ഫോൺ: 2365040

ഫാക്സ് : 2366875  
കോർപ്പറേഷൻ ഓഫീസ്  
കോഴിക്കോട്

ഹെൽത്ത് സൂപ്പർവൈസർ

എഫ്8/91748/2022

തീയതി, 14.02.2023

## ശുചിത്വ നിലവാര സാക്ഷ്യപത്രം.

കോഴിക്കോട് മുനിസിപ്പൽ കോർപ്പറേഷൻ പരിധിയിലെ ഇലക്ട്രൽ വർഡ് 73-ൽ ഉൾപ്പെട്ട പുതിയങ്ങാടിയിലുള്ള AL-HARAMAIN ഇംഗ്ലീഷ് മീഡിയം സ്കൂളിന്റെ പ്രിൻസിപ്പാൾ ശ്രീമതി.ടി.എ.സഫിയ എന്നവരുടെ അപേക്ഷയുടെയും, അനുബന്ധരേഖകളുടെയും അടിസ്ഥാനത്തിൽ 14-ാം ഹെൽത്ത് സർക്കിൾ ഇൻസ്പെക്ടറുടെ 11.01.2023 ലെ സ്ഥല പരിശോധന റിപ്പോർട്ട് പ്രകാരം ആവശ്യമായ ആരോഗ്യ ശുചിത്വ സംവിധാനങ്ങളും, മാലിന്യസംസ്കരണ മാർഗ്ഗങ്ങളും സജ്ജീകരിച്ചിട്ടുണ്ട് എന്ന് റിപ്പോർട്ട് ചെയ്തിട്ടുള്ളതിനാൽ മേൽ സ്ഥാപനത്തിന്റെ ശുചിത്വ നിലവാരം തൃപ്തികരമാണെന്ന് സാക്ഷ്യപ്പെടുത്തുന്നു.


To


Mrs. T. M. SAFIA  
Principal  
Al-Haramain English School  
P.O. Edakkad, Puthiyangadi  
Kozhikode - 673 005 Kerala

ശ്രീമതി.ടി.എ.സഫിയ,  
AL-HARAMAIN ഇംഗ്ലീഷ് മീഡിയം സ്കൂൾ,  
പുതിയങ്ങാടി,  
എടക്കാട്.(പി.ഒ),  
കോഴിക്കോട്-673 005

ഹെൽത്ത് സൂപ്പർവൈസർ  
കോഴിക്കോട് മുനിസിപ്പൽ കോർപ്പറേഷൻ

Dr. A. V. ABDUL AZEEZ  
Manager  
Al Haramain English School  
P.O. Edakkad, Puthiyangadi  
Kozhikode - 673 005



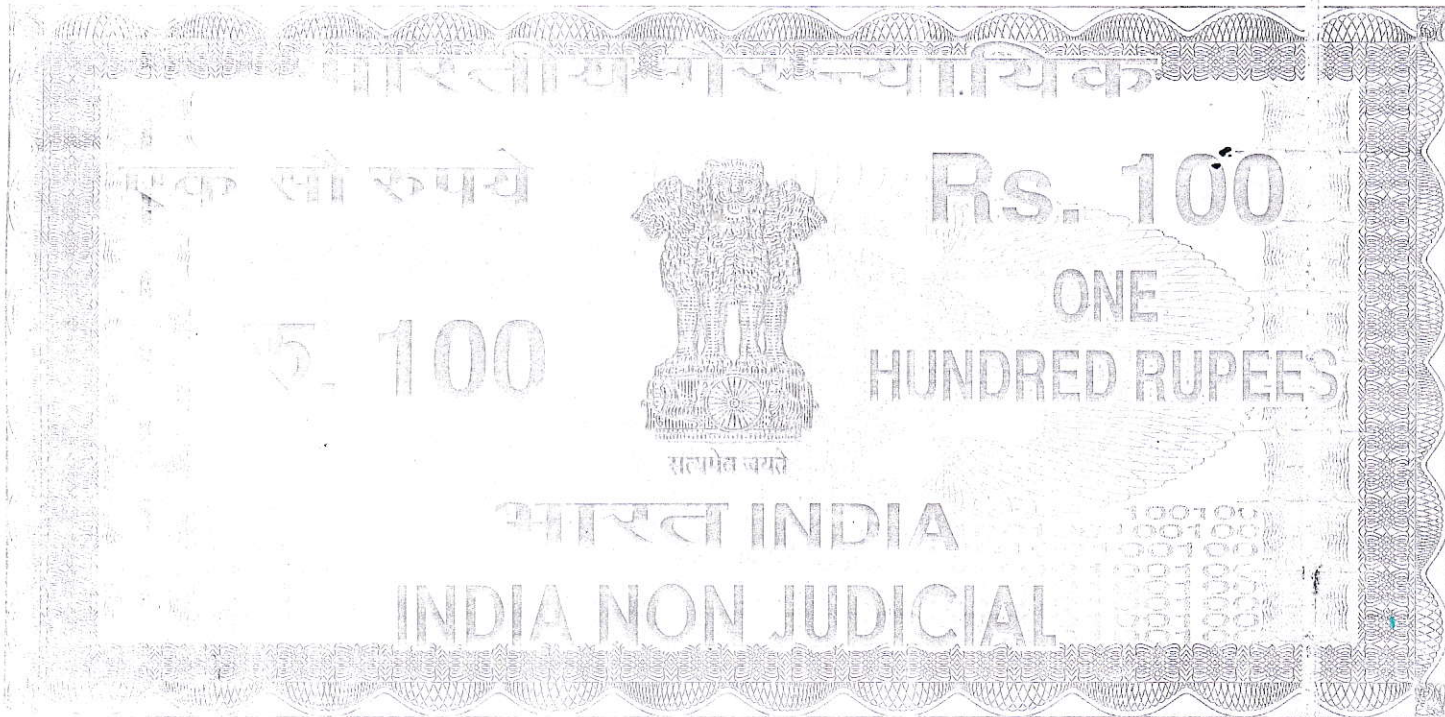

കേരളം കേരल KERALA

KOZHIKODE MUNICIPAL CORPORATION

DX 310269

Email: [Secretarykkd@gmail.com](mailto:Secretarykkd@gmail.com) Website : [www.kozhikodecorporation.lsgkerala.gov.in](http://www.kozhikodecorporation.lsgkerala.gov.in)

Phone 2365040

Fax: 2366875

Health Supervisor

Corporation Office Kozhikode

F8/91748/2022

Date .14.02.2023

SANITATION CERTIFICATE

Based on the application and supporting documents of Mrs T A Safia, Principal of AL- HARAMAIN English Medium School, Puthiyangadi, Electoral Ward73, Kozhikode Municipal Corporation limits, as per the site inspection dated 11.01.2023 of the 14<sup>th</sup> Health Circle Inspector, It has been reported that the required health and hygiene systems and waste disposal methods have been set up as satisfactory. Certifies that the hand.

To,

Sd/-

Mrs. T A Safiya

Health supervisor

Al- HARAMAIN English Medium School


Kozhikode Municipal Corporation


Puthiyangadi, Edakkad.P.O, Kozhikode- 673005

Dr. A. V. ABDUL AZEEZ  
Manager  
Al Haramain English School  
P.O. Edakkad, Puthiyangadi  
Kozhikode - 673 005



*Handwritten signature and 'true transaction'*  
Mrs. T. M. SAFIA  
Principal  
Al-Haramain English School  
Opp. AIR Station, Puthiyangadi  
P.O. Edakkad, Calicut-673 005, Kerala

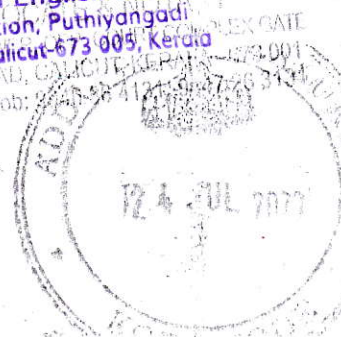

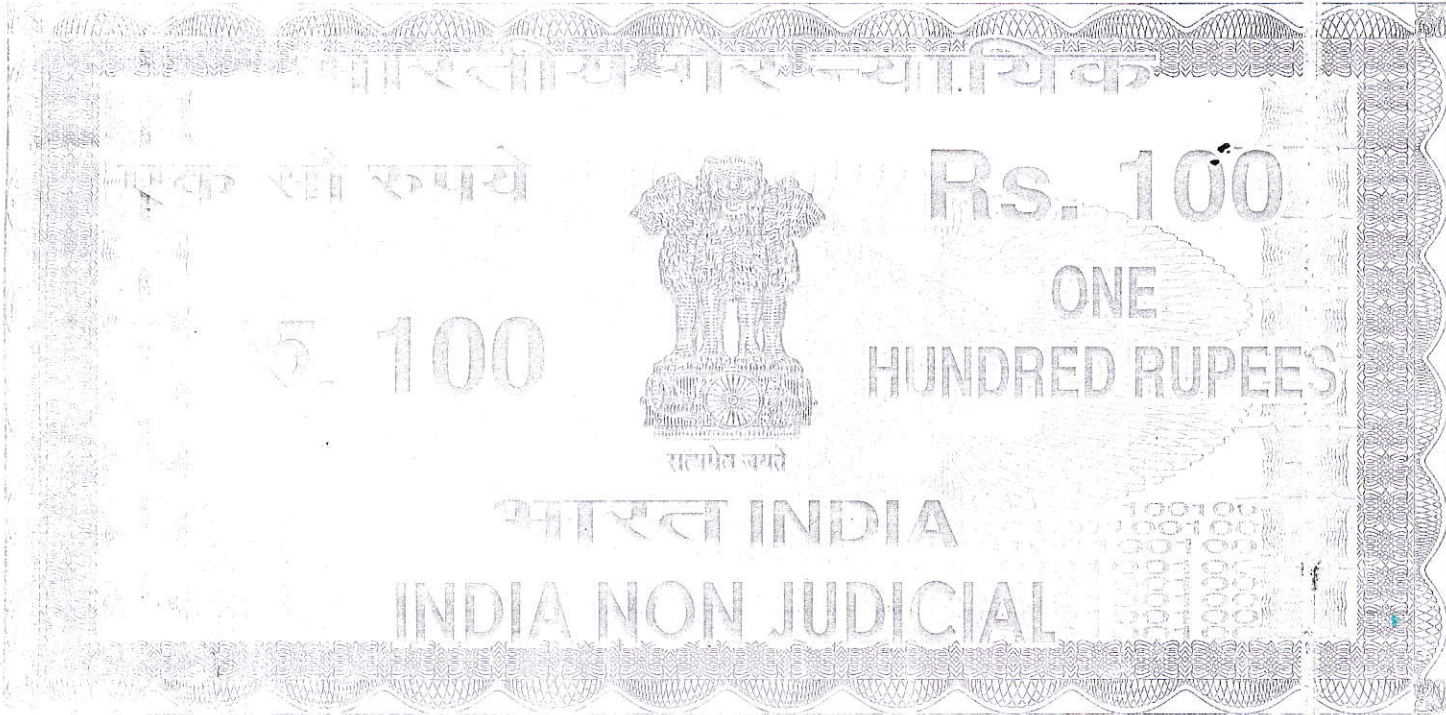

കേരളം KERALA

KOZHIKODE MUNICIPAL CORPORATION

DX 310269

Email: [Secretarykd@gmail.com](mailto:Secretarykd@gmail.com) Website : [ww.kozhikodecorporation.lsgkerala.gov.in](http://ww.kozhikodecorporation.lsgkerala.gov.in)

Phone 2365040

Fax: 2366875

Health Supervisor

Corporation Office Kozhikode

F8/91748/2022

Date .14.02.2023

SANITATION CERTIFICATE

Based on the application and supporting documents of Mrs T A Safia, Principal of AL- HARAMAIN English Medium School, Purthiyangadi, Electoral Ward73, Kozhikode Municipal Corporation limits, as per the site inspection dated 11.01.2023 of the 14<sup>th</sup> Health Circle Inspector, It has been reported that the required health and hygiene systems and waste disposal methods have been set up as satisfactory. Certifies that the hand.

To,

Sd/-

Mrs. T A Safiya

Health supervisor

Al- HARAMAIN English Medium School


Kozhikode Municipal Corporation

Puthiyangadi, Edakkad.P.O, Kozhikode- 673005

Dr. A. V. ABDUL AZEEZ  
Manager  
Al Haramain English School  
P.O. Edakkad, Puthiyangadi  
Kozhikode - 673 005




Mrs. T. M. SAFIA  
Principal  
Al-Haramain English School  
Opp. AIR Station, Puthiyangadi  
P.O. Edakkad, Calicut-673 005, Kerala  
S. INDIA. Mob: 9447130770

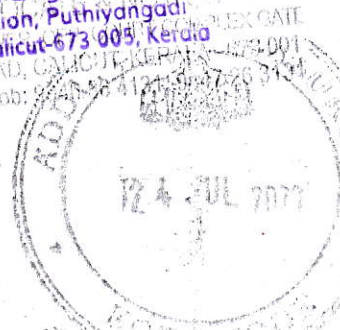



**KSCSTE - CENTRE FOR WATER RESOURCES  
DEVELOPMENT AND MANAGEMENT**  
**ജലവിഭവ വികസന വിനിയോഗ കേന്ദ്രം**



KSCSTE-CWRDM An Institution of Kerala State Council for Science, Technology & Environment, Govt. of Kerala  
കേരള ശാസ്ത്ര സാങ്കേതിക പരിസ്ഥിതി കൗൺസിൽ സ്ഥാപനം, കേരള സർക്കാർ



TC-8713

**CWRDM WATER QUALITY DIVISION-TESTING LABORATORY**

**TEST REPORT**

No: CWRDM/WQD/WA/2023/6245

|  |                              |             |
|--|------------------------------|-------------|
| <b>Customer Name and Address:</b><br>Alharamain School<br>Puthiyangadi | Date of Issue                | :06-01-2023 |
|  | Date of receipt of sample    | :22-12-2022 |
|  | SRF No                       | :6045       |
|  | Test Report No               | :6245       |
|  | Analysis Started             | :22-12-2022 |
|  | Analysis Completed           | :05-01-2023 |
| <b>Information Provided by Customer:</b>                               |                              |             |
| Sample Description   | Water Sample (1L,Pipe Water) |             |
| Sample Drawn by  | HI Kozhikode Corporation     |             |

**TEST RESULTS-CHEMICAL ANALYSIS**

| Sl. No. | Parameters                                       | Test Method   | Result | Limit of Quantification (LOQ) | Acceptable limit as per IS 10500:2012 |
|---------|--|---|--------|-------------------------------|---------------------------------------|
| 1       | pH at 25°C                                       | APHA, 2017 (Part 4500 H+)                             | 7.03   | 1.0                           | 6.50-8.50                             |
| 2       | Colour, Hazen                                    | APHA, 2017 (Part 2120)                                | BDL    | 1.0                           | 5.0                                   |
| 3       | Turbidity, NTU                                   | APHA, 2017(Part 2130)                                 | 1.0    | 0.20                          | 1.0                                   |
| 4       | Total Dissolved Solids, mg/l                     | APHA, 2017 (Part 2540)                                | 31.0   | 10.0                          | 500.0                                 |
| 5       | Total Hardness as CaCO <sub>3</sub> , mg/l       | APHA, 2017 (Part 2340)                                | 16.0   | 2.0                           | 200.0                                 |
| 6       | Total Alkalinity as CaCO <sub>3</sub> , mg/l     | APHA, 2017 (Part 2320)                                | 11.88  | 2.0                           | 200.0                                 |
| 7       | Chloride as Cl <sup>-</sup> , mg/l               | APHA, 2017(Part 4500 Cl <sup>-</sup> )                | 4.08   | 4.0                           | 250.0                                 |
| 8       | Sulphate as SO <sub>4</sub> <sup>2-</sup> , mg/l | APHA, 2017 (Part 4500 SO <sub>4</sub> <sup>2-</sup> ) | 1.92   | 1.0                           | 200.0                                 |
| 9       | Calcium as Ca, mg/l                              | APHA, 2017 (Part 3500 Ca)                             | 6.40   | 1.0                           | 75.0                                  |
| 10      | Magnesium as Mg, mg/l                            | APHA, 2017 (Part 3500 Mg)                             | 1.0    | 1.0                           | 30.0                                  |
| 11      | Iron as Fe, mg/l                                 | APHA, 2017 (Part 3500 Fe)                             | BDL    | 0.20                          | 1.0                                   |

BDL-Below Detection Level

For CWRDM, Water Quality Division – Testing Laboratory

Tested by

Authorised Signatory

**WATER QUALITY DIVISION**  
**CENTRE FOR WATER RESOURCES DEVELOPMENT AND MANAGEMENT**  
**KOZHIKODE-673571**

**TEST RESULTS- BACTERIOLOGICAL ANALYSIS**

| Sl. No. | Parameters                 | Test Method             | Result | Acceptable limit as per IS 10500:2012       |
|---------|----------------------------|-------------------------|--------|---|
| 1       | Total Coliforms, CFU/100ml | APHA, 2017(Part 9222 B) | Absent | Shall not be detectable in any 100ml sample |
| 2       | <i>E.coli</i> , CFU/100ml  | APHA, 2017(Part 9222 G) | Absent | Shall not be detectable in any 100ml sample |

**Note:-**

All the tested water quality parameters are found to be within the acceptable limit as per IS 10500:2012, Drinking Water Specification.


\*\*\*\*\*End of the Report\*\*\*\*\*


For CWRDM, Water Quality Division – Testing Laboratory

  
Tested by

  
Authorised Signatory

**Note:** This test report refers only to the particular item(s) submitted for testing. The test results reported in this report are valid at the time of and under the stated condition of measurement. This particular test report cannot be reproduced except in full, without prior permission of Head – Water Quality Division of the laboratory. Any discrepancies may be brought to the laboratory within 30 days of the issue of the report.

  
**Mrs. T. M. SAFIA**  
Principal  
Al-Haramain English School  
Opp. A/R Station, Puthiyangadi  
P.O. Edakkad, Calicut-673 005, Kerala

  
**Dr. A. V. ABDUL AZEEZ**  
Manager  
Al Haramain English School  
P.O. Edakkad, Puthiyangadi  
Kozhikode - 673 005